


Valerie Falls Discharge Jan. 1 to Dec. 31 2005 (December 31, 2005)
Operational Plan (from Seine River Water Management Plan)

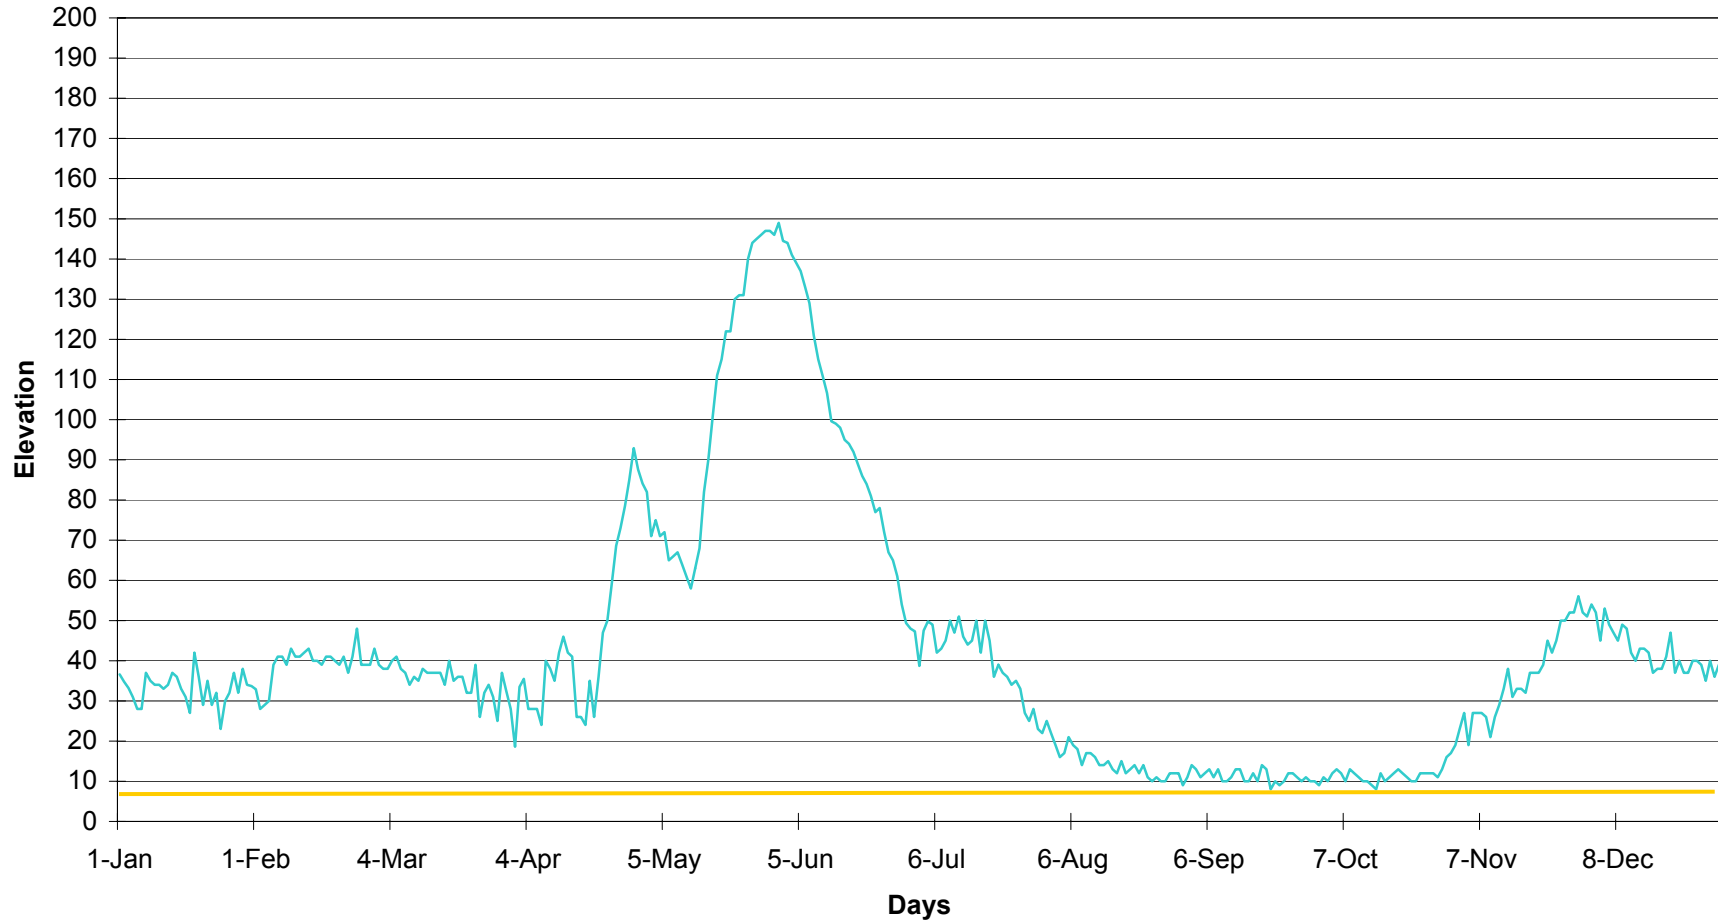

— Actual Discharge Min. Flow 8 m3/sec —