


Valerie Falls Discharge January 1 to December 31, 2007

Average Daily Inflow

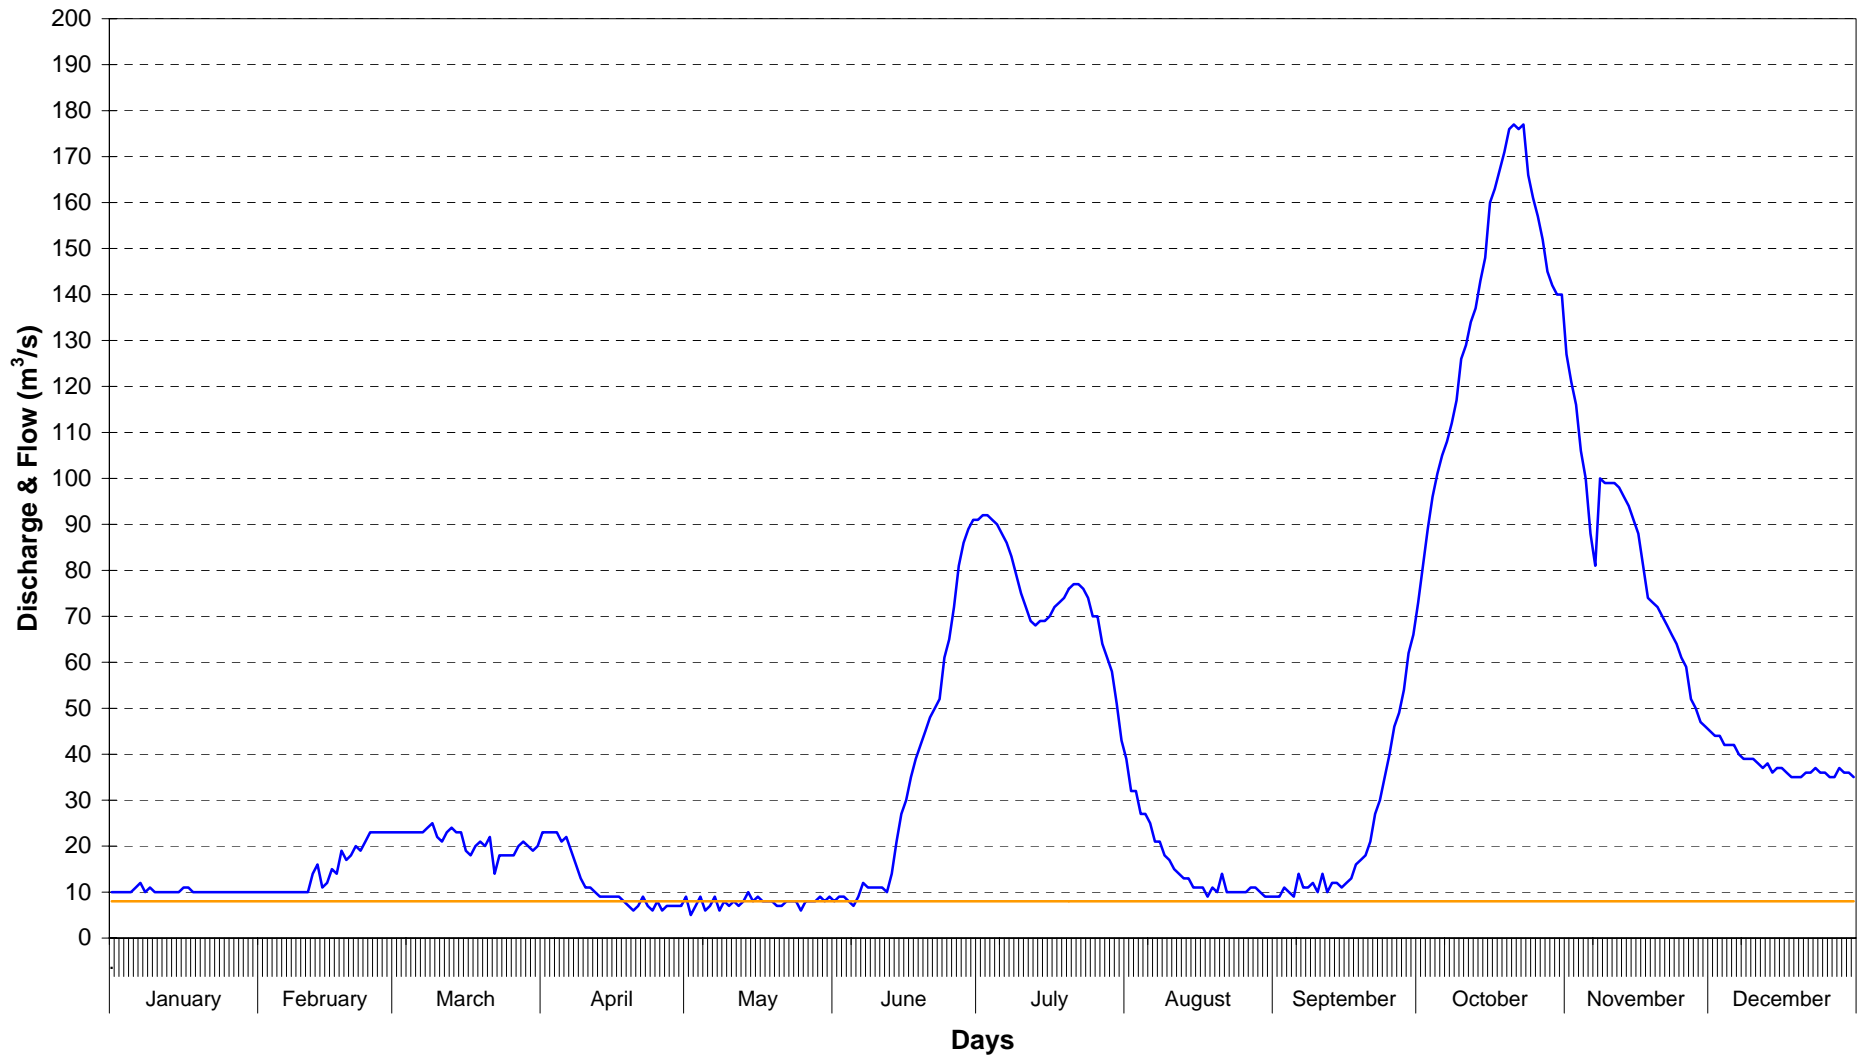

— Average Daily Inflow — Minimum Flow (8 m³/sec)